

No.: SHIN2006035526CM

Date: Jul 30, 2020

Page: 1 of 14



ADDRESS: ASCENDAS XINSU SQUARE, 5 XINGHAN STREET, SUZHOU,

JIANGSU, CHINA

Sample Name : RINGLOCK SCAFFOLD

Product Specification : Please see the below table

Product or Lot No. : Please see the below table

Above information and sample(s) was/were submitted and confirmed by the client. SGS, however, assumes no responsibility to verify the accuracy, adequacy and completeness of the sample information provided by client.

Test Required : Please see the next page(s)
Ref. Standard : Please see the next page(s)

Date of Receipt : Jun 17, 2020
Testing Start Date : Jun 17, 2020
Testing End Date Jul 27, 2020

Test result(s) : For further details, please refer to the following page(s)

(Unless otherwise stated the results shown in this test report refer only to

the sample(s) tested)

Signed for

SGS-CSTC Standards Technical Service (Shanghai)Co., Ltd.

Tiffany Liu

Authorized signatory





No.: SHIN2006035526CM

Date: Jul 30, 2020

Page: 2 of 14

Ref.No	Product Specification		
RV33	Ringlock Standard 1.0m		
RV66	Ringlock Standard 2.0m		
RH207	Ringlock Ledger 2.07m		
RH109	Ringlock Ledger 1.09m		
RDB207	Ringlock Diagonal Brace 2.07x2.0m		
RDB109	Ringlock Diagonal Brace 1.09x2.0m		
ROSP32207	Ringlock Steel Plank 2.07x0.32m		
ROSP32109	Ringlock Steel Plank 1.09x0.32m		
RTB207	Ringlock Steel Toeboard 2.07m		
RTB109	Ringlock Steel Toeboard 1.09m		
CSJB600	Ringlock Base Jack 600mm		
RSC-L	Ringlock Base Collar 310mm		
RUHEAD600	Ringlock U Head Screw Jack 600mm		





No.: SHIN2006035526CM

Date: Jul 30, 2020

Page: 3 of 14

Original Sample Photo(s):





No.: SHIN2006035526CM

Date: Jul 30, 2020

Page: 4 of 14

Test conducted:

EN 12810-1:2003 Facade scaffolds made of prefabricated components-Part 1: Products specifications EN 12811-1:2003 Temporary works equipment Part 1: Scaffolds – Performance requirements and general design

Test Results:

Test Clause	Test item	Test Requirement	Test Result	Conclusion
6.2.2	Steel tubes (circular)	For 2.0m standard (Φ48.3mm): t (wall thickness) =3.2mm (claimed by client); R (Yield strength) ≥235N/mm² Tolerance of the wall thickness: ±10%	t=3.25mm; R=536N/mm² Tolerance of the all thickness: 1.6%	Pass
7.3.1	Further requirements- general	a) Every area for access and working shall be so arranged as to provide a convenient working place; b) Attention shall be paid to ergonomic consideration; c) The area shall be fully decked and shall be provided with appropriate side protection; d) Connections between separate parts shall be effective and easy to monitor and easy to assemble and secure against accidental disconnection.	It satisfies the requirement of a), b), c) and d)	Pass



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at http://www.sgs.com/en/Terms-and-Conditions.aspx and, for electronic format document subject to Terms and Conditions for Electronic Document as http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx Attention is drawn to the limitation of liability, indemnification and jurisdiction issues define therein. Any holder of this document advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduce appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing impaction report & certificate, please contact us at telephone: (86-755) 8307 144*



No.: SHIN2006035526CM

Date: Jul 30, 2020

Page: 5 of 14

7.3.1	Further requirements-general	0.9m ≤ w (width of bay) ≤1.2m; c (free walking space) ≥500mm; b (clear distance between standards) ≥600mm; h3(clear head height between working areas) ≥1900mm.	W=1090mm; c=1043mm; b=955mm; h ₃ =1928mm.	Pass
7.3.2	Side protection	The distance between the top of principal and the adjacent level above of the working area d₁≥1000mm	d ₁ =1003mm	Pass
		The distance between the intermediate and adjacent principal d₂≤470mm	d ₂ =450mm	Pass
7.3.3	Base jacks	Base jacks shall have a minimum adjustment of 200mm	The base jack can be adjusted at least 300mm	Pass
		The area of the end plate shall be a minimum of 150 cm ² . The minimum width shall be 120 mm	The area of end plate is 225cm². The width is 150mm	Pass
		The inclination of the axis of the shaft from the standard does exceed 2.5%	The inclination of the axis of the shaft from the standard is 1.6%	Pass
		The minimum overlap length at any position of adjustment shall be 25% of the total length of the shaft, or 150mm which is greater	The minimum overlap length of adjustment is 300mm	Pass
		The thickness of the endplate shall be at least 6 mm	The thickness of the endplate is 6 mm	Pass



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at http://www.sgs.com/en/Terms-and-Conditions.aspx.and, for electronic Documents at http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx.
Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its invervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, which they are the supportance of the document is unleavily and offenders may be prosecuted to the fullest extent of the law. Unloss otherwise stated the Attention. To check the authenticity of testing/Inspection report a certificate, please contact us at telephone: (86-755) 8307 1443, ore mail: CND.Doccheck@sps.com"

No.89, Block 1159, East Kang Qiao Road, Pudong District, Shanghai, China. 201319 t(86-21) 61196300 f(86-21) 61191853 /68183920 www.sgsgroup.com.cn 中国・上海・浦东康桥东路1159弄69号 邮编: 201319 t(86-21) 61196300 f(86-21) 61191853 /68183920 e e sgs.china@sgs.com



No.: SHIN2006035526CM

Date: Jul 30, 2020

Page: 6 of 14

7.3.4 Platfor		For the versatility of platform height, the scaffold include components to enable: a) The erection of adjacent pairs of standards on surfaces which differ in level by any amount up to 2.0m b) the erection of a single platform at any height between 2.0m and 24.0m	The scaffold includes components to satisfy the requirement of a) and b).	Pass
	Platform	a) Platform units should have a slip-resistant surfaceb) Working area shall be as level as possible.	It satisfies the requirement of a) and b).	Pass
		 c) The decking components should close any gap between them wider than 25mm. d) Where a standard separates parts of a platform, the distance between these parts shall not be more than 80mm 	c), No decking components provided by the client d), N/A	N/A
8.1	Actions	All system configurations shall resist the combination of loads without any visual deformation.	See Appendix A	Pass
Test clause of	conclusion			
Test clause does not apply to test object			N/A	
Test item does meet the requirement			Pass(P)	
Test item does not meet the requirement			Fail(F)	

Note: Maximum extended height of base jack is 300mm as per client's requirement.



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at http://www.sgs.com/en/Terms-and-Conditions.aspx and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at http://www.sgs.com/en/Terms-and-Conditions/Terms-en-Document.aspx. Attention is drawn to the limitation of liability, indemnification and jurisdiction susues defined rerein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction document. This document cannot be reproduced appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

**Attention: To check the attenticity of testing inspection report a certificate, please contact us at telephone; (86-755) 8307 1443,



No.: SHIN2006035526CM

Date: Jul 30, 2020

Page: 7 of 14

Appendix A: Detail test result of load test and test photos

I. Requirements for structural design-actions

Test method:

EN 12811-1:2003 Temporary works equipment Part 1: Scaffolds – Performance requirements and general design & Clause 6.2.9 Load combinations test in the service condition.

1. Sample information

Table 1 The weight of designed bay, GaNote

Scaffold components	Unit Mass (kg)	Number of components in design bay (36m design height)	The weight of design bay, G _d (kg)
Ringlock Standard 1.0m	4.86	4	
Ringlock Standard 2.0m	10.09	72	
Ringlock Ledger 2.07m	8.47	110	
Ringlock Ledger 1.09m	4.76	110	
Ringlock Diagonal Brace 2.07×2.0m	10.1	36	
Ringlock Diagonal Brace 1.09×2.0m	8.41	36	4153.52
Ringlock Steel Plank 2.07×0.32m	16.29	54	4100.02
Ringlock Steel Toeboard 2.07m	6.5	36	
Ringlock Steel Toeboard 1.09m	3.52	36	
Ringlock Base Jack 600mm	3.3	4	
Ringlock Base Coller 310mm	1.7	4	
Ringlock U Head Screw Jack 600mm	6.39	4	

Note: G_d =for one bay, the self weight of the assembled scaffold at its maximum design height, including all components, such as steel plank, scaffolding standard, base collar and so on.



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at http://www.sgs.com/en/Terms-and-Conditions.aspx and, for electronic format document subject to Terms and Conditions for Electronic Documents at http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues define therein. Any holder of this document advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to transaction from exercising all their rights and obligations under the transaction documents. This document and the representation of the subject of the company's company and the responsibility of the company and the responsibility to the finding transaction from the produced of the company and the responsibility of the finding intervention of the company and the responsibility of the company and the responsibility of the finding intervention of the company and the responsibility of the



No.: SHIN2006035526CM

Date: Jul 30, 2020

Page: 8 of 14

Table 2 The weight of test bay, GtNote

Scaffold components	Unit Mass (kg)	Number of components in test bay (6.41m test height)	The weight of test bay, G _t (kg)
Ringlock Standard 1.0m	/	0	
Ringlock Standard 2.0m	9.04	12	
Ringlock Ledger 2.07m	8.12	20	
Ringlock Ledger 1.09m	4.52	20	
Ringlock Diagonal Brace 2.07×2.0m	9.09	6	
Ringlock Diagonal Brace 1.09×2.0m	7.71	6	735.52
Ringlock Steel Plank 2.07×0.32m	16.25	12	700.02
Ringlock Steel Toeboard 2.07m	5.81	4	
Ringlock Steel Toeboard 1.09m	3.16	4	
Ringlock Base Jack 600mm	3.88	4	
Ringlock Base Coller 310mm	1.68	4	
Ringlock U Head Screw Jack 600mm	5.08	4	

Note: G_t =for one bay, the weight of the assembled scaffold as erected to the height for the test, including all the components.

Table 3 Service loads on working areas

EN 12811-1:2003 stipulates that the service uniformly distributed load applied to a working area for a load class 6 shall be 6.00kN/m².

Load class on working area	Class 6
The number of working area in design bay	Three working areas
Uniformly distributed load q ₁ kN/m ²	6






No.: SHIN2006035526CM

Date: Jul 30, 2020

Page: 9 of 14

2. Scaffold configuration in test:

The maximum design height of scaffold system was 36m according to client's instruction while the scaffold assembly installed in test was one bay wide (1090mm) and one bay long (2070mm), by three lifts high, the height of each lift was 2000mm. The maximum extension height of the adjustable leg was 300mm.

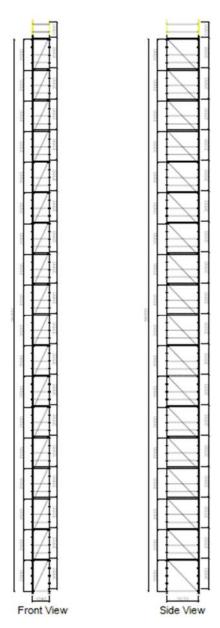



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printer overleaf, available on request or accessible at http://www.gas.com/en/Terms-and-Conditions.aspx.and, for electronic format documents subject to Terms and Conditions for Electronic Documents at http://www.sgs.com/en/Terms-and-Conditions/Terms-en-Document.aspx.attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined rein. Any holder of this document advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits or client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a ransaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced asppearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.


**Attention: To check the authenticity of testing rimspection report a certificate, please contact us at telephone: (86-755) 8307 1443.



No.: SHIN2006035526CM

Date: Jul 30, 2020

Page: 10 of 14

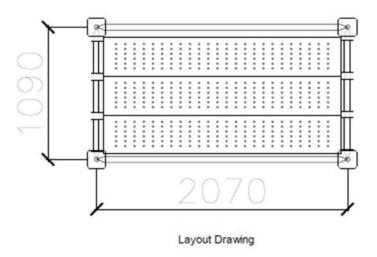

Scaffold configuration



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printer overleaf, available on request or accessible at http://www.sgs.com/en/Terms-and-Conditions.aspx.and, for electronic format documents subject to Terms and Conditions for Electronic Documents at <a href="http://www.sgs.com/en/Terms-en-Conditions/Terms-en-Document.aspx.attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined rein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits or client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a ransaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced asppearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

**Attention: To check the authenticity of testing rinspection report a certificate, please contact us at telephone: (86-755) 8307 1443.



No.: SHIN2006035526CM

Date: Jul 30, 2020

Page: 11 of 14

3. Load calculation:

1) Self weight of the scaffold:

A vertical load was applied simulating the action of self weight of the scaffold assembly at the maximum design height in one bay on the standards. The load was distributed on the four standards through load beams.

 $F_v = G_d - G_t = 4153.52 - 735.52 = 3418 \text{kgf},$

 Uniformly distributed service load appropriate to the class of the working scaffold specified in Table 3, column 2, acting on the working area of the most unfavourable decked level.

Specification of the steel plank: 2070mm (Length) x 320mm (Width)

Number of steel plank in three working platforms: 9pcs

 $F_u=q_1\times L\times W=6.0\times 2.07\times 0.32\times 9\times 1000/9.8=3650 kgf$

3) 50% of the load specified in 2) shall be taken to act on the working area at the next level above or below if a working scaffold has more than one decked level.

 $F_{u50\%}$ =3650×50%=1825kgf

4) Horizontal working load specified in 6.2.3.

Horizontal working load:

 $F_{dh1}=F_u \times 2.5\%=894N;$

F_{dh2}=300N;

 $F_{dh}=300N$ (For each bay considered the notional horizontal load shall be not less than 2.5% of the total of the uniformly distributed load, q_1 , specified in Table 3, on that bay, or 0.3kN, which is greater.)

 $F_{th}=H_d\times F_{dh}/H_t=36.41\times 894/6.41=5078N$





No.: SHIN2006035526CM

Date: Jul 30, 2020

Page: 12 of 14

4. Test procedure:

Apply the load combinations to the scaffold assembly, check the scaffold whether it be capable of resisting the worst combinations of loads to which it is likely to be subjected. The horizontal load shall be applied parallel and perpendicular to the bay separately.

5. Test results:

1) Horizontal working load parallel to the bay

Test Item	Test height	Value of Load		Test result	Conclusion
		Self weight	3418kgf		
Load		Uniformly distributed service load	3650kgf	The scaffold was capable of resisting	
combinations (Service condition)	(Service 6.41m	50% of the uniformly distributed service load	1825kgf	the combination of loads without any visual deformation.	Pass
		Horizontal working load	5078N		





No.: SHIN2006035526CM

Date: Jul 30, 2020

Page: 13 of 14

2) Horizontal working load perpendicular to the bay

Test Item	Test height	Value of Load		Test result	Conclusion
		Self weight	3418kgf		
		Uniformly distributed	3650kgf	The scaffold was	
Load		service load	Sosokyi	capable of	
combinations	6.41m	50% of the uniformly		resisting the	Pass
(Service	0.41111	distributed service	1825kgf	combination of	1 433
condition)		load		loads without any	
		Horizontal working	5078N	visual deformation.	
		load	OU/8IN		




No.: SHIN2006035526CM

Date: Jul 30, 2020

Page: 14 of 14

Test photo(s):







Horizontal working load parallel to the bay

******* End of report******



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at https://www.sg.com/en/Terms-and-Conditions.agp.and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at https://www.sg.com/en/Terms-and-Conditions/Terms-e-Document.aspx.. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

**Attention: To check the authenticity of testing rinspection report a certificate, please contact us at telephone: (86-755) 5307 1443,